


PLAN VIEW

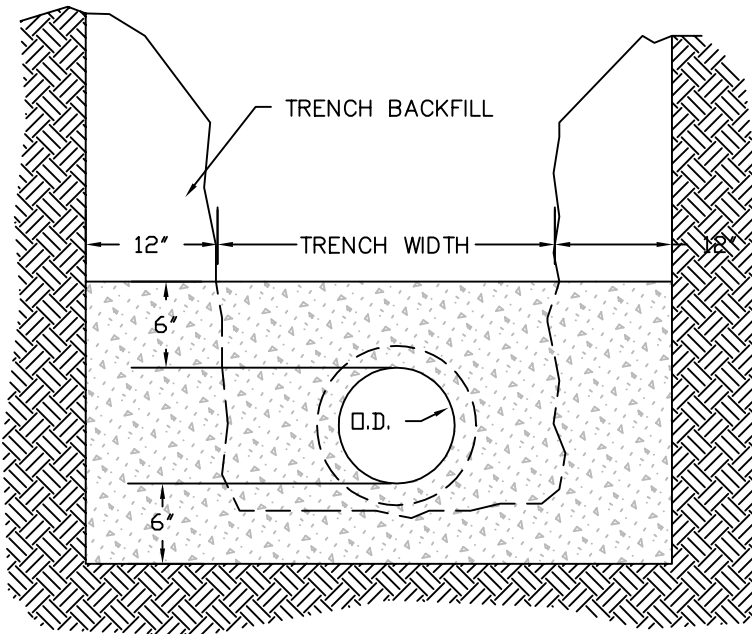

SECTION "A - A"

NOTES:

1. CONCRETE SHALL BE 3000 P.S.I.
2. REINFORCING SHALL BE No. 4 BARS @ 12" E.W.
3. REINFORCING BARS SHALL BE DEFORMED AND TIED TOGETHER.
4. ANCHOR SPACING SHALL BE:

SLOPE	SPACING
20-35%	36 FT.
35-50%	24 FT.
> 50%	16 FT.
5. DUCTILE IRON PIPE MUST BE USED WHEN SLOPES ARE 20% OR GREATER
6. KEYING PIPES IS REQUIRED FOR ALL DIP INSTALLED @ 20% OR GREATER GRADE.

STANDARD DETAIL	
Metropolitan Sewerage District of Buncombe County, North Carolina	
KEYING PIPES ON SLOPES	
APPROVED: FEBRUARY 25, 2010	3.02-03